
PROP. PAY LIMIT OF HMA SURF. REMOVAL
FULL THICKNESS OF MILLING
TEMP. RAMP
(NOTE "C")
(NOTE "E")

EXIST. PAVEMENT

MILLED TEMPORARY RAMP
(FOR BUTT JOINT AND HMA TAPER SEE DETAIL BELOW)

### OPTION 1

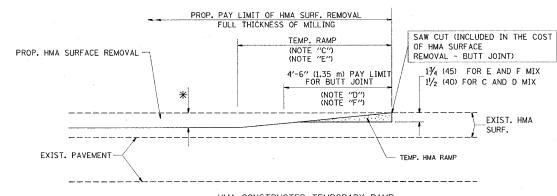


HMA CONSTRUCTED TEMPORARY RAMP

(FOR BUTT JOINT AND HMA TAPER SEE DETAIL BELOW)

### OPTION 2

### TYPICAL TEMPORARY RAMP

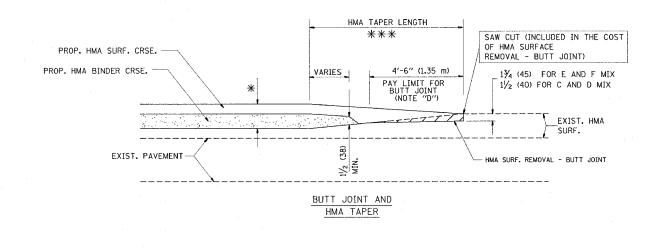

TYPICAL BUTT JOINT AND HMA TAPER
FOR MILLING AND RESURFACING

PROP. HMA OR PCC

SURFACE


SURFACE REMOVAL - BUTT JOINT

30'-0" (9.0 m) (NOTE "A')

(NOTE "D')

SAW CUT (INCLUDED IN THE COST OF HMA OR P.C.C. SURFACE REMOVAL - BUTT JOINT)

BUTT JOINT DETAIL

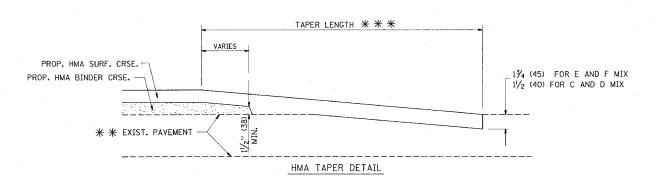

# TYPICAL BUTT JOINT AND HMA TAPER FOR RESURFACING ONLY

\* \* PC CONCRETE, HMA OR HMA RESURFACED PAVEMENT.

\* \* EXIST. PAVEMENT

#### NOTES

- A: MAINLINE ROADWAYS AND MAJOR SIDE ROADS.
- B: MINOR SIDE ROADS.
- $\mathbf{C}\textsc{:}$  THE TEMP. RAMP SHALL BE CONSTRUCTED IMMEDIATELY UPON REMOVAL OF THE EXISTING HMA SURFACE.
- D: THE BUTT JOINT SHALL BE CONSTRUCTED IMMEDIATELY PRIOR TO PLACING THE PROPOSED HMA COURSES.
- E: TAPER THE TEMP. RAMP AT A RATE OF 3'-O" (900 mm) PER 1 INCH (25 mm) OF MILLING THICKNESS.
- F: INSTALLATION AND REMOVAL OF THE 4'-6" (1.35 m) TEMP. RAMP IS INCLUDED IN COST OF HMA SURFACE REMOVAL BUTT JOINT
- G: SEE ARTICLE 406.08 AND 406.14 OF THE STANDARD SPECIFICATIONS FOR "HMA AND/OR PCC SURFACE REMOVAL, BUTT JOINT".
- \* SEE TYPICAL SECTIONS FOR MILLING THICKNESS.
- # # 20'-0" (6.1 m) PER 1 (25) RESURFACING (NOTE "A") 10'-0'' (3.0 m) PER 1 (25) RESURFACING (NOTE "B")

ALL DIMENSIONS ARE IN INCHES (MILLIMETERS) UNLESS OTHERWISE SHOWN.

## BASIS OF PAYMENT:

THE BUTT JOINT WILL BE PAID FOR AT THE CONTRACT UNIT PRICE PER SQUARE YARD (SQUARE METER) FOR "HOIT-MIX ASPHALT SURFACE REMOVAL - BUTT JOINT" OR FOR "PORTLAND CEMENT CONCRETE SURFACE REMOVAL- BUTT JOINT".

DATE 6-13-90 7-3-90 3-27-92 09/09/94
7-3-90 3-27-92 09/09/94
3-27-92 09/09/94
09/09/94
10/25/94
03/21/97
04/06/01
01/01/07

ILLINOIS DEPARTMENT OF TRANSPORTATION

BUTT JOINT AND HMA TAPER DETAILS

SCALE: VERT. NONE

DRAWN BY CHECKED BY

CONTRACT NO.

13/4 (45) FOR E AND F MIX

11/2 (40) FOR C AND D MIX

BD400-05 (VI=BD32)